


Notated dimensions and/or levels to be used only. All dimensions and/or levels must be site checked by the Contractor prior to commencing any construction work. Any discrepancies must be reported to the Engineer. No assumptions are to be made regarding this drawing.

IMPORTANT : DO NOT SCALE FROM THIS DRAWING

This drawing is the copyright of FLN Consulting Engineers and must not be copied or reproduced without prior permission.

**NOTES**

1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS AND DOCUMENTATION INCLUDED IN CONTRACT
2. DRAWING IS NOT TO SCALE.
3. LAYOUTS SHOWN ARE INDICATIVE ONLY, AND SHOULD BE CONFIRMED WITH ARCHITECTURAL LAYOUTS.

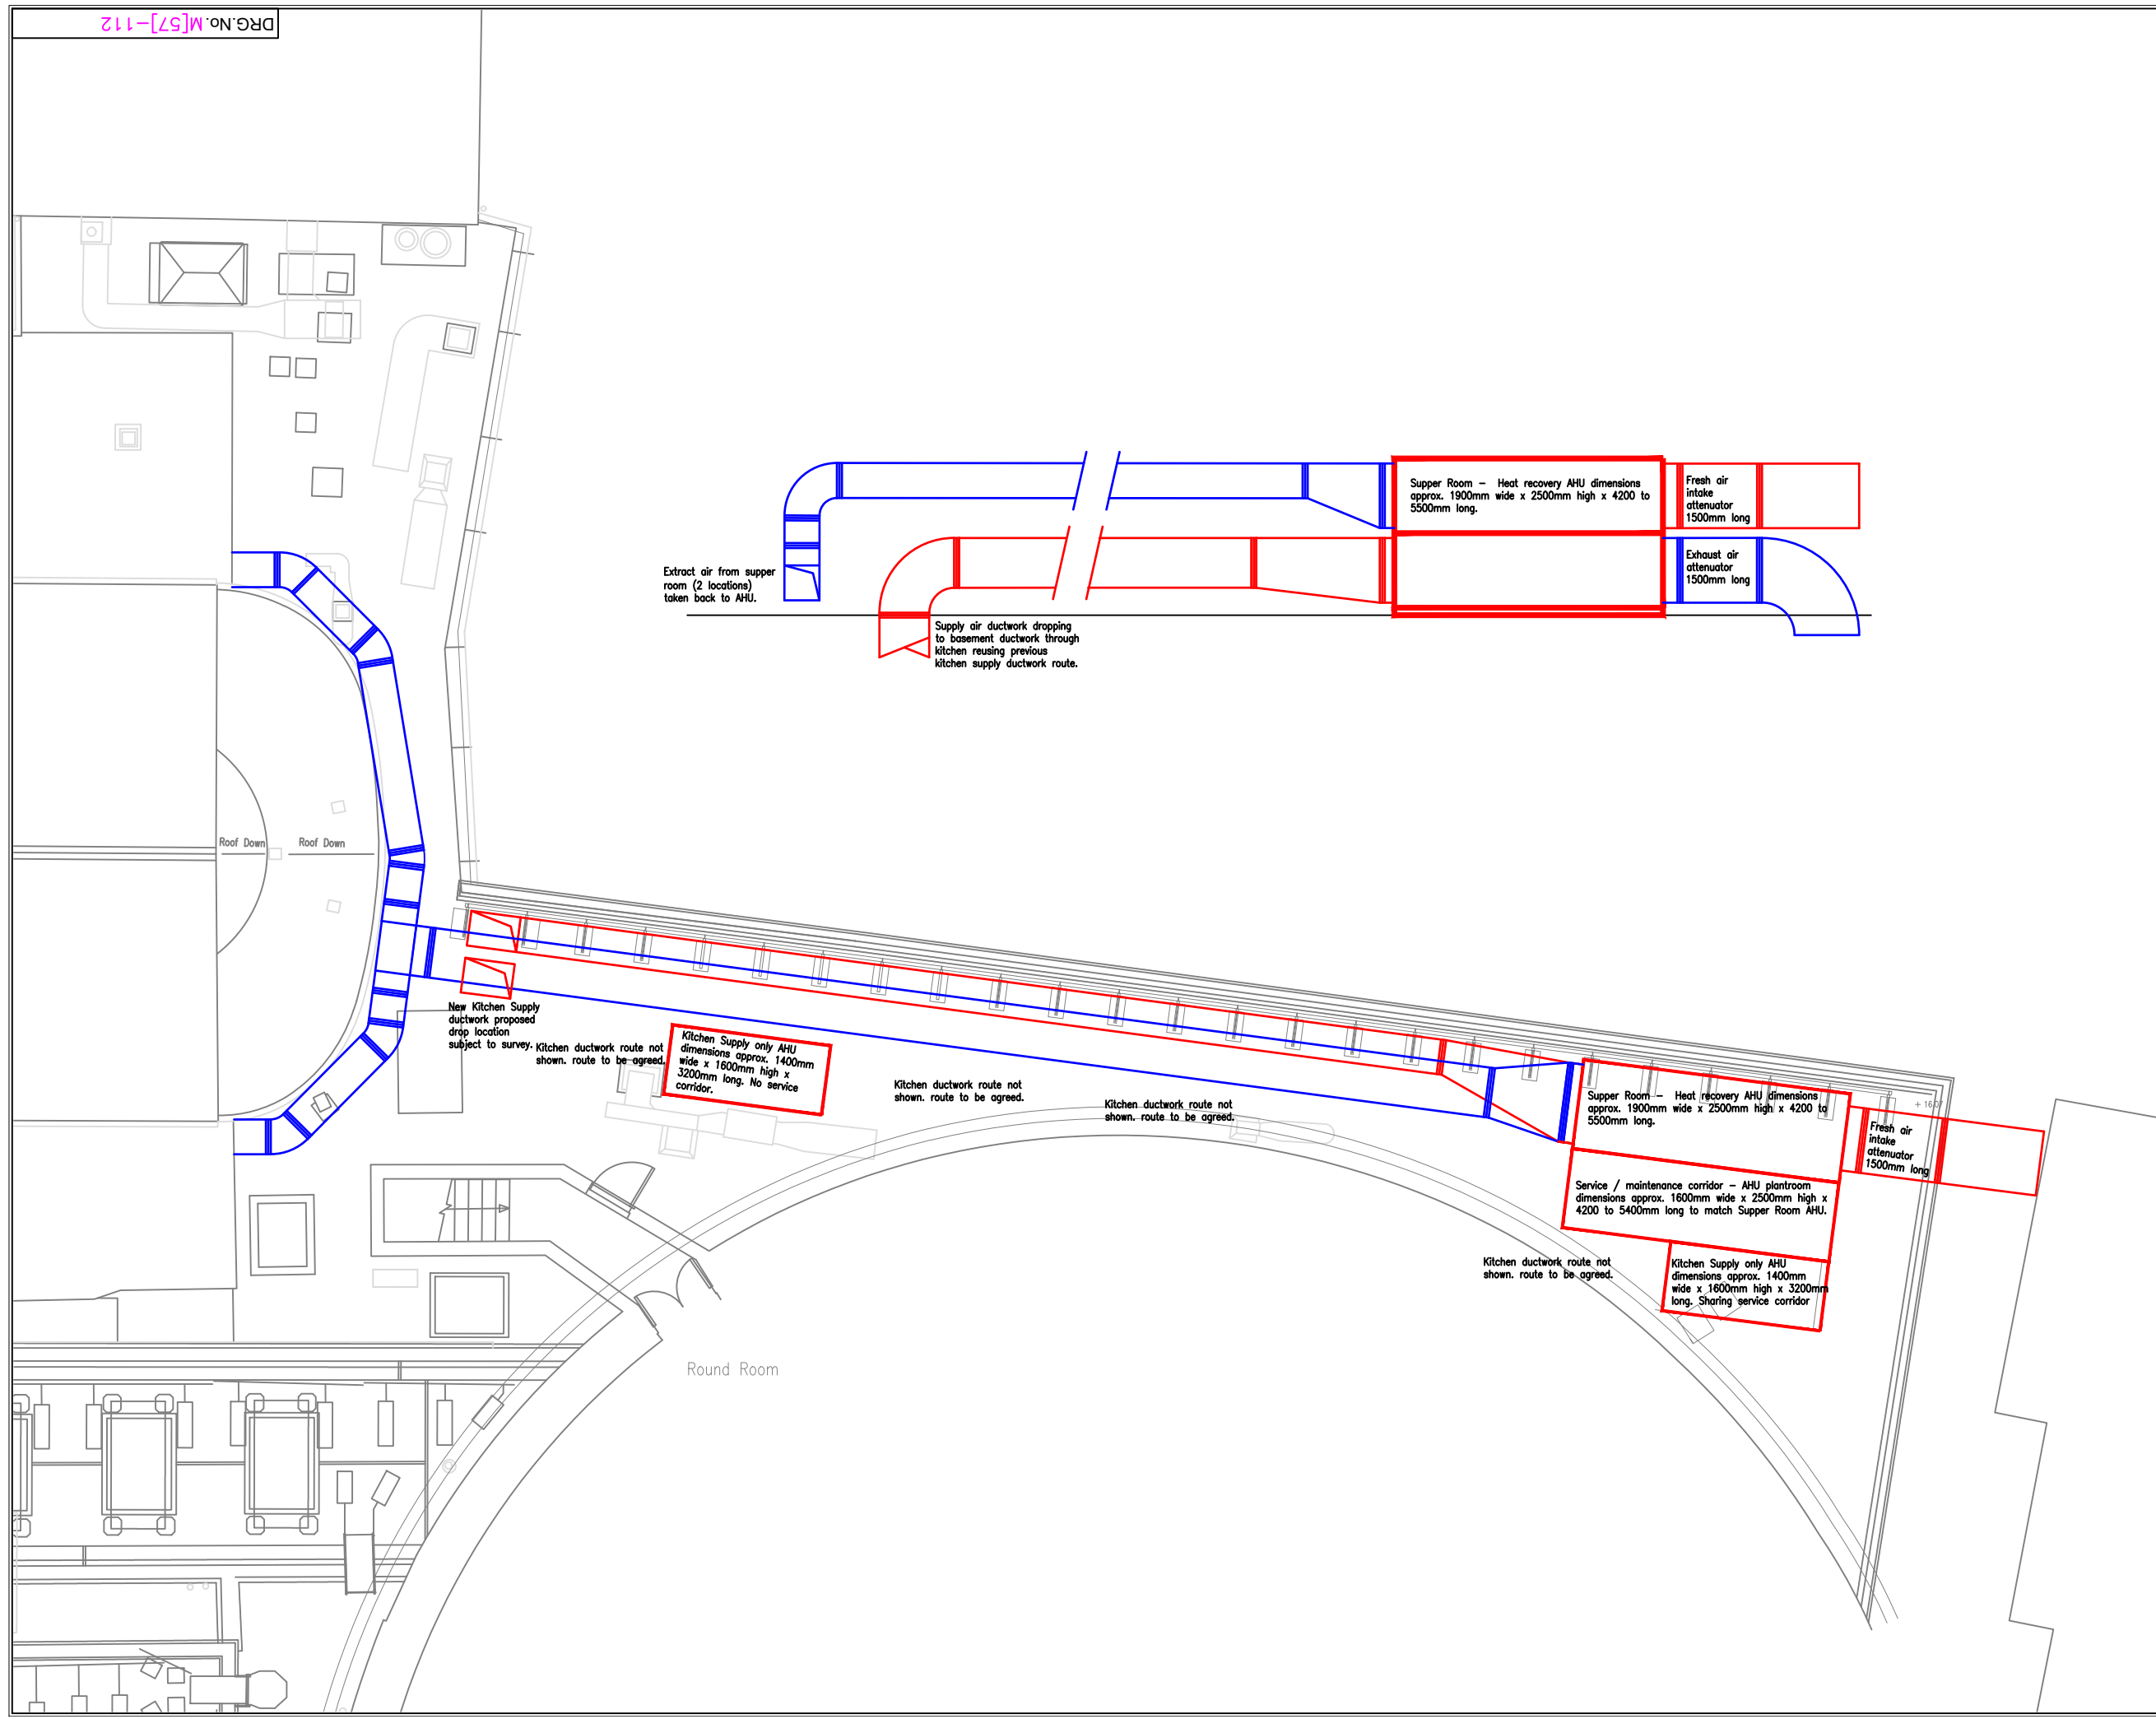

ref	by	chk	date	revision
				Second Floor 13 South Leinster Street Dublin 2 Ireland t: +353 (0)1 678 7832 www.flnconsult.com info@flnconsult.com
GLASGOW • DUBLIN • AYR • INVERNESS				
Drg Status <b>PART 8 SUBMISSION</b>				
Architect <b>Blackwood Associates Architects</b>				
Contract <b>MANSION HOUSE DUBLIN 2</b>				
Title <b>Proposed Ventilation System Comprising Kitchen Supply Only and Supper Room Heat Recovery AHU - First / Roof Level Part 8 Planning Application</b>				
Drn	Date	Chk	Date	
DGA	19.04.2023	DGA	19.04.2023	
Scale 1:125 @ A3			(or as shown)	Current Rev S1
JOB No. 3416				
DRG. No. M[57]-112				